


NOTES:

1. Casing size and thickness shall conform to the minimum requirements of the Dept. Of Public Works and other permits, as required.
2. Maintain 1/2 inch minimum clearance between the maximum outside diameter of carrier pipe and casing at all locations.
3. Dimensions are approximate only. Contractor shall install adequately sized casing to accommodate the carrier pipe.

SCHEDULE OF CASING		
CARRIER PIPE	NOMINAL CASING	MIN. WALL THICKNESS (IN.)
6"	12"	0.11
8"	14"	0.15
10"	16"	0.18
12"	18"	0.20

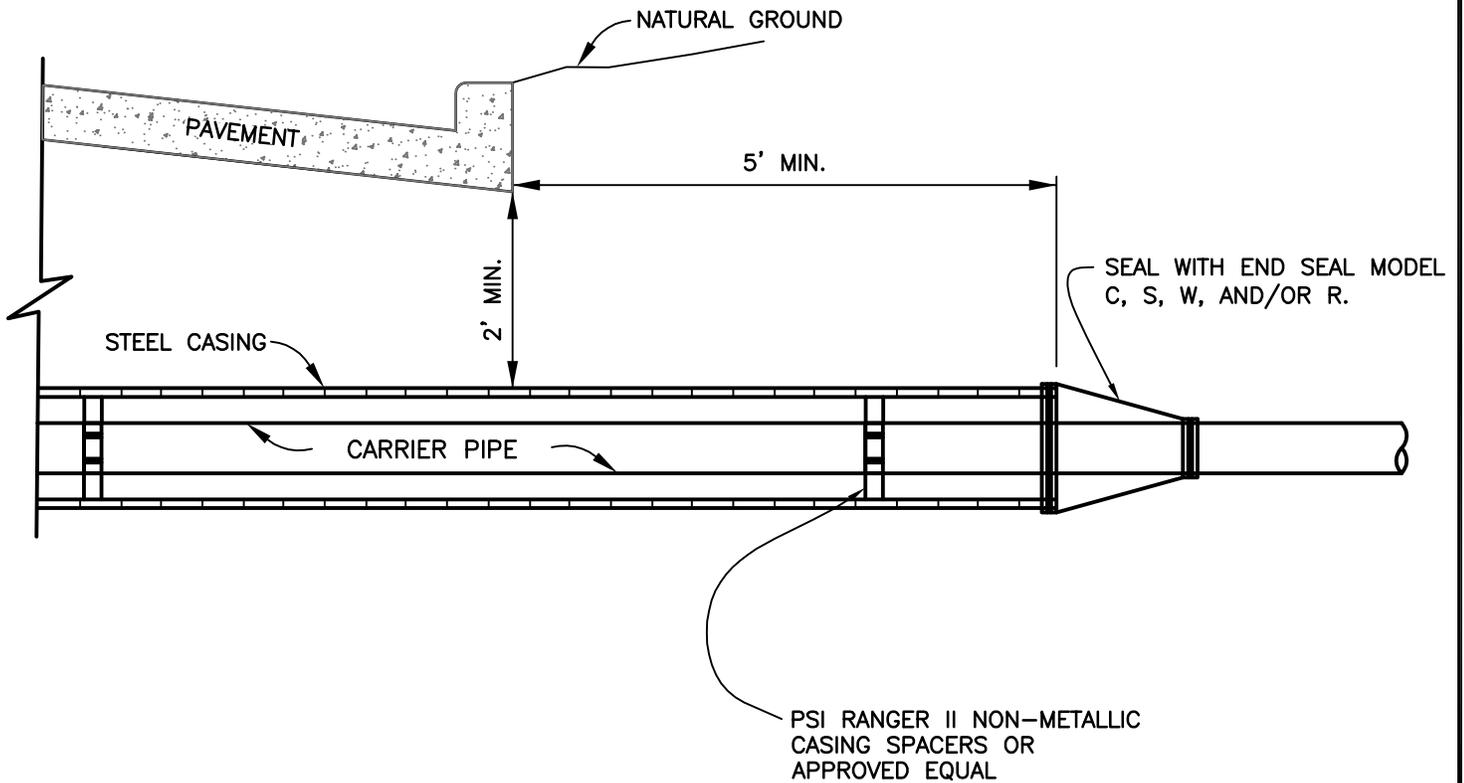

ELEVATION VIEW

SPACING REQUIREMENTS:

1. Max. 8' between spacers
2. Max. 2' from casing pipe end.
3. Max. 2' on each side of bell or mechanical joint.

THE CITY OF ROSENBERG, FORT BEND COUNTY, TEXAS
DEPARTMENT OF PUBLIC WORKS

SANITARY SEWER LINE
ENCASEMENT

DESIGN: CAK	CAD: STAFF	SCALE: NTS	DATE: 12/10	DRAWING: S-103
----------------	---------------	---------------	----------------	-------------------