


FOR A LINE TO PASS OVER AN OBSTRUCTION RATHER THAN UNDER, IT MUST HAVE ADEQUATE COVER AND BE APPROVED BY DEPARTMENT OF PUBLIC WORKS.

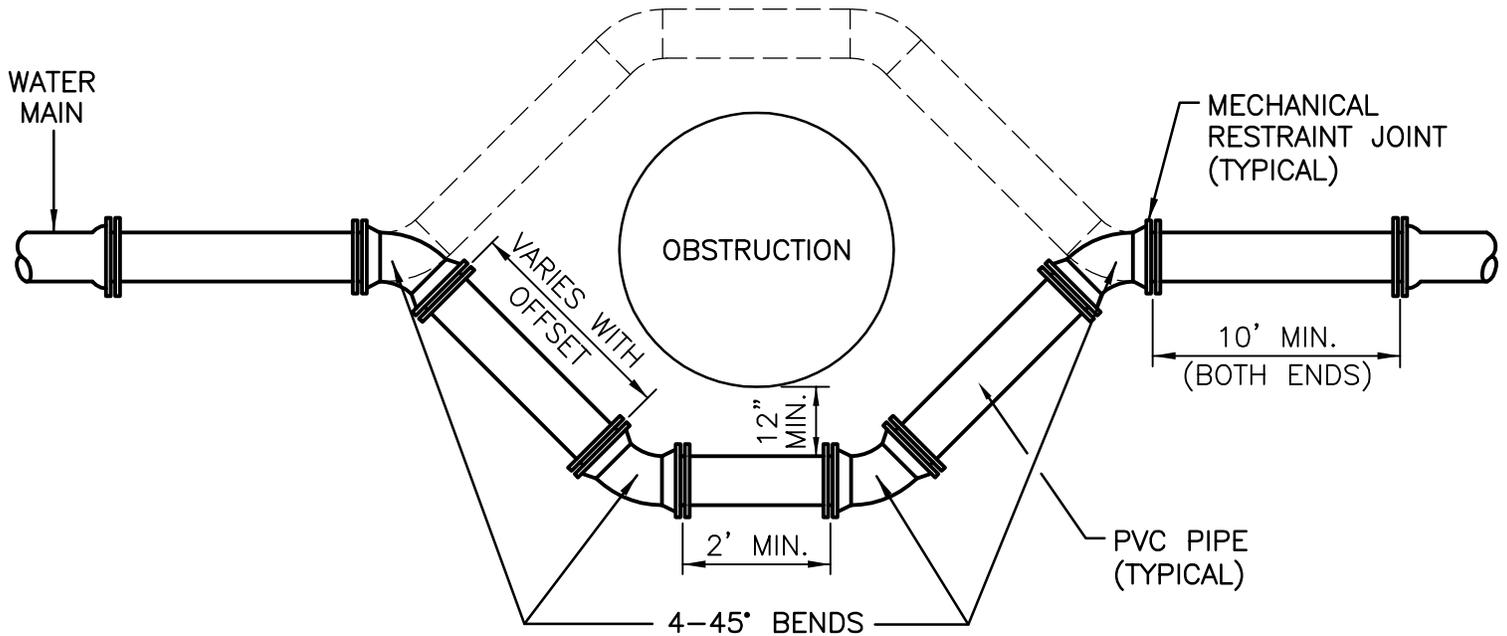

NOTES:

1. PIPE—AWWA C900 DR-18, 150 PSI WITH INTEGRAL PVC JOINT.
2. FITTINGS—DUCTILE IRON EPOXY LINED AND COATED, MECHANICAL JOINT, MEGALUG JOINT RESTRAINT, OR APPROVED EQUAL.
3. PROVIDE 2-5/8" ALL-THREAD STAINLESS STEEL RODS BETWEEN ALL FITTINGS.
4. HIGH DENSITY POLYETHYLENE PIPE & FITTINGS, HEAT FUSION MAY BE USED AS AN ALTERNATE AS APPROVED BY DEPARTMENT OF PUBLIC WORKS.
5. WELDED STEEL PIPE SECTIONS MAY BE USED AS AN ALTERNATE AS APPROVED BY DEPARTMENT OF PUBLIC WORKS.

THE CITY OF ROSENBERG, FORT BEND COUNTY, TEXAS  
DEPARTMENT OF PUBLIC WORKS

WATER PIPE  
OFFSET ASSEMBLY

DESIGN: CAK	CAD: STAFF	SCALE: NTS	DATE: 11/11	DRAWING: W-105
----------------	---------------	---------------	----------------	-------------------